

This Page Is Inserted by IFW Operations
and is not a part of the Official Record

BEST AVAILABLE IMAGES

Defective images within this document are accurate representations of the original documents submitted by the applicant.

Defects in the images may include (but are not limited to):

- BLACK BORDERS
- TEXT CUT OFF AT TOP, BOTTOM OR SIDES
- FADED TEXT
- ILLEGIBLE TEXT
- SKEWED/SLANTED IMAGES
- COLORED PHOTOS
- BLACK OR VERY BLACK AND WHITE DARK PHOTOS
- GRAY SCALE DOCUMENTS

IMAGES ARE BEST AVAILABLE COPY.

**As rescanning documents *will not* correct images,
please do not report the images to the
Image Problem Mailbox.**

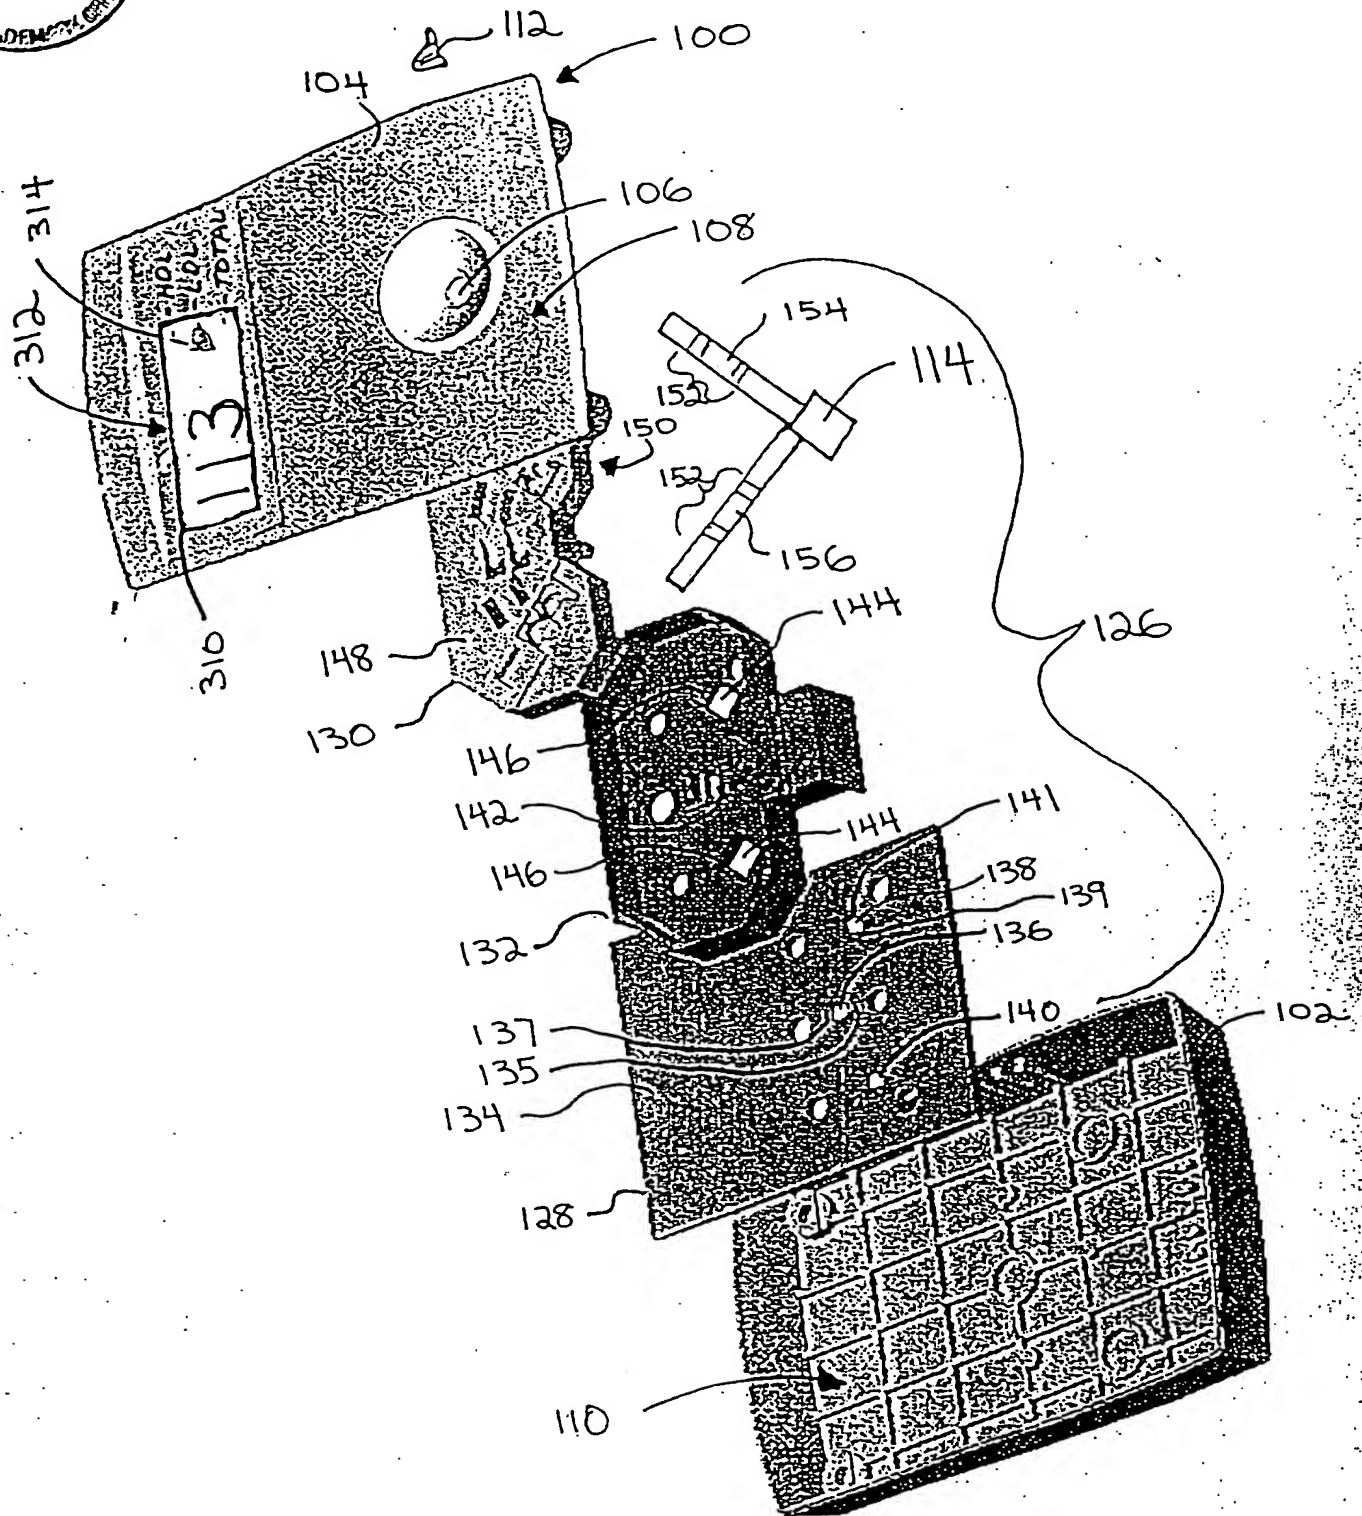


FIG. 1



APPLN. FILING DATE: HERewith
TITLE: DRY REAGENT STRIP CONFIGURATION,
COMPOSITION AND METHOD OF MULTIPLE ANALYTE
DETERMINATION

INVENTOR(S): JOEL M. BLATT ET AL.
ATTORNEY'S DOCKET NO: 033819-016

SHEET 2 of 14

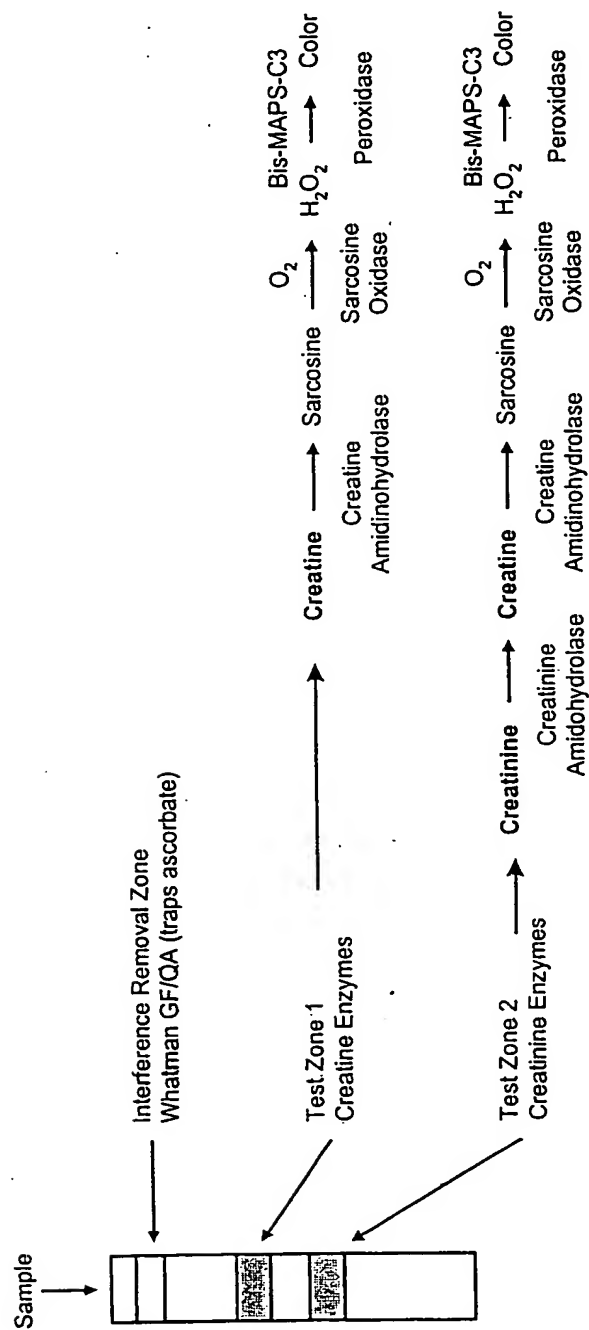



Fig. 2



APPLN. FILING DATE: HERewith
TITLE: DRY REAGENT STRIP CONFIGURATION,
COMPOSITION AND METHOD OF MULTIPLE ANALYTE
DETERMINATION

INVENTOR(S): JOEL M. BLATT ET AL.
ATTORNEY'S DOCKET NO: 033819-016

SHEET 3 of 14

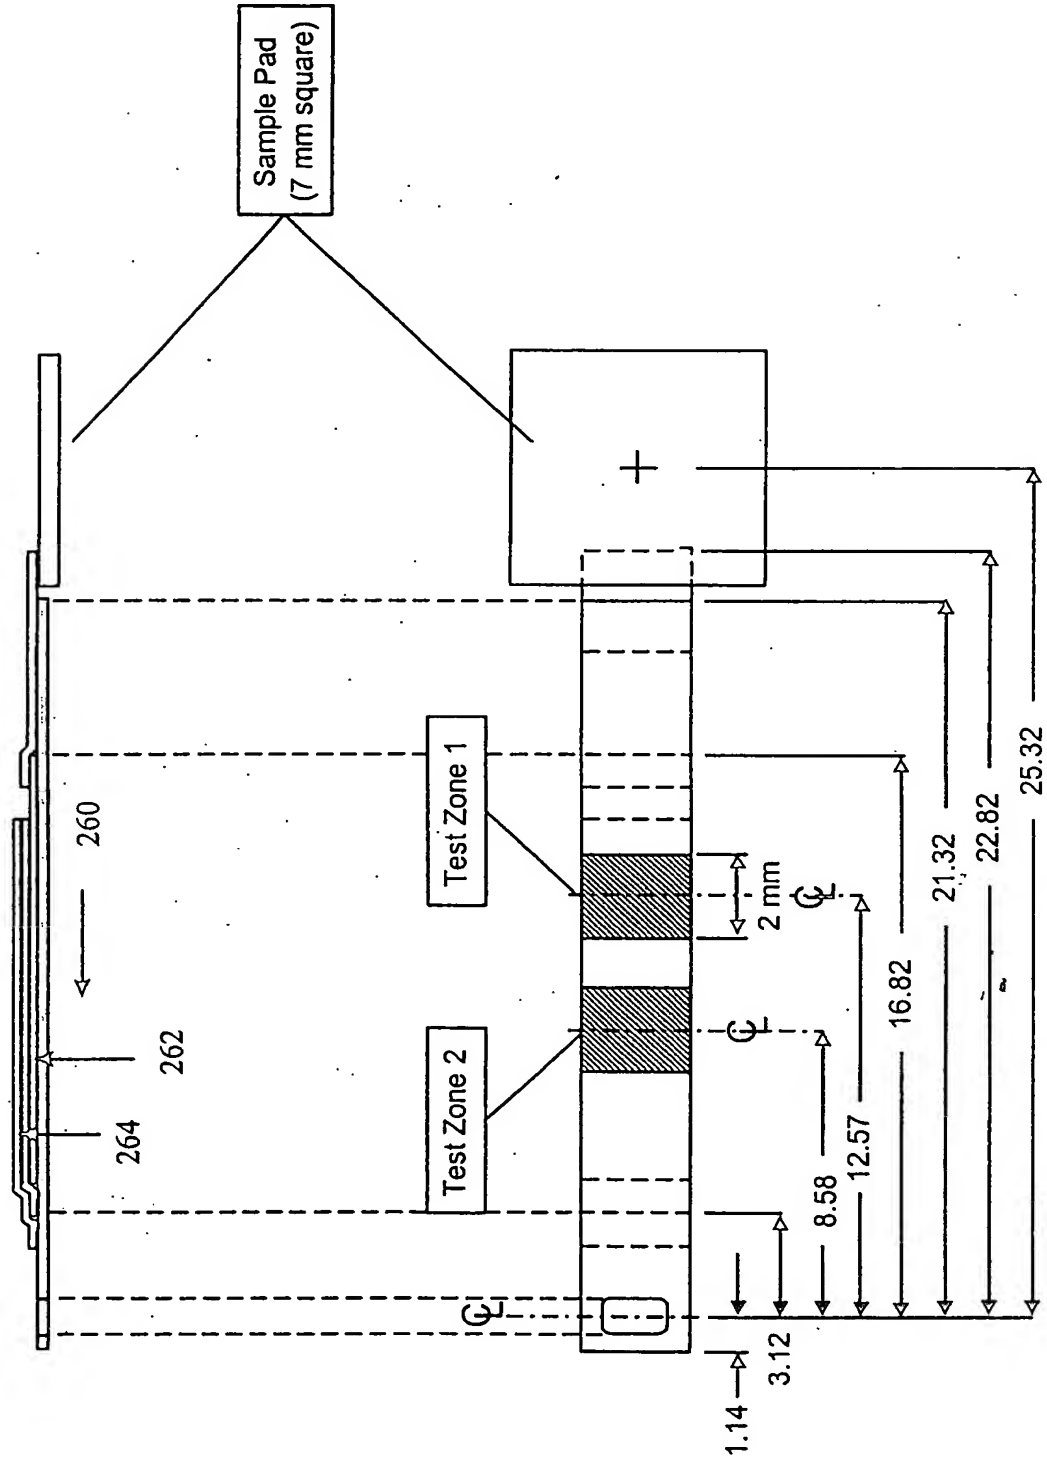

Side View

Fig. 3A

Top View

Fig. 3B

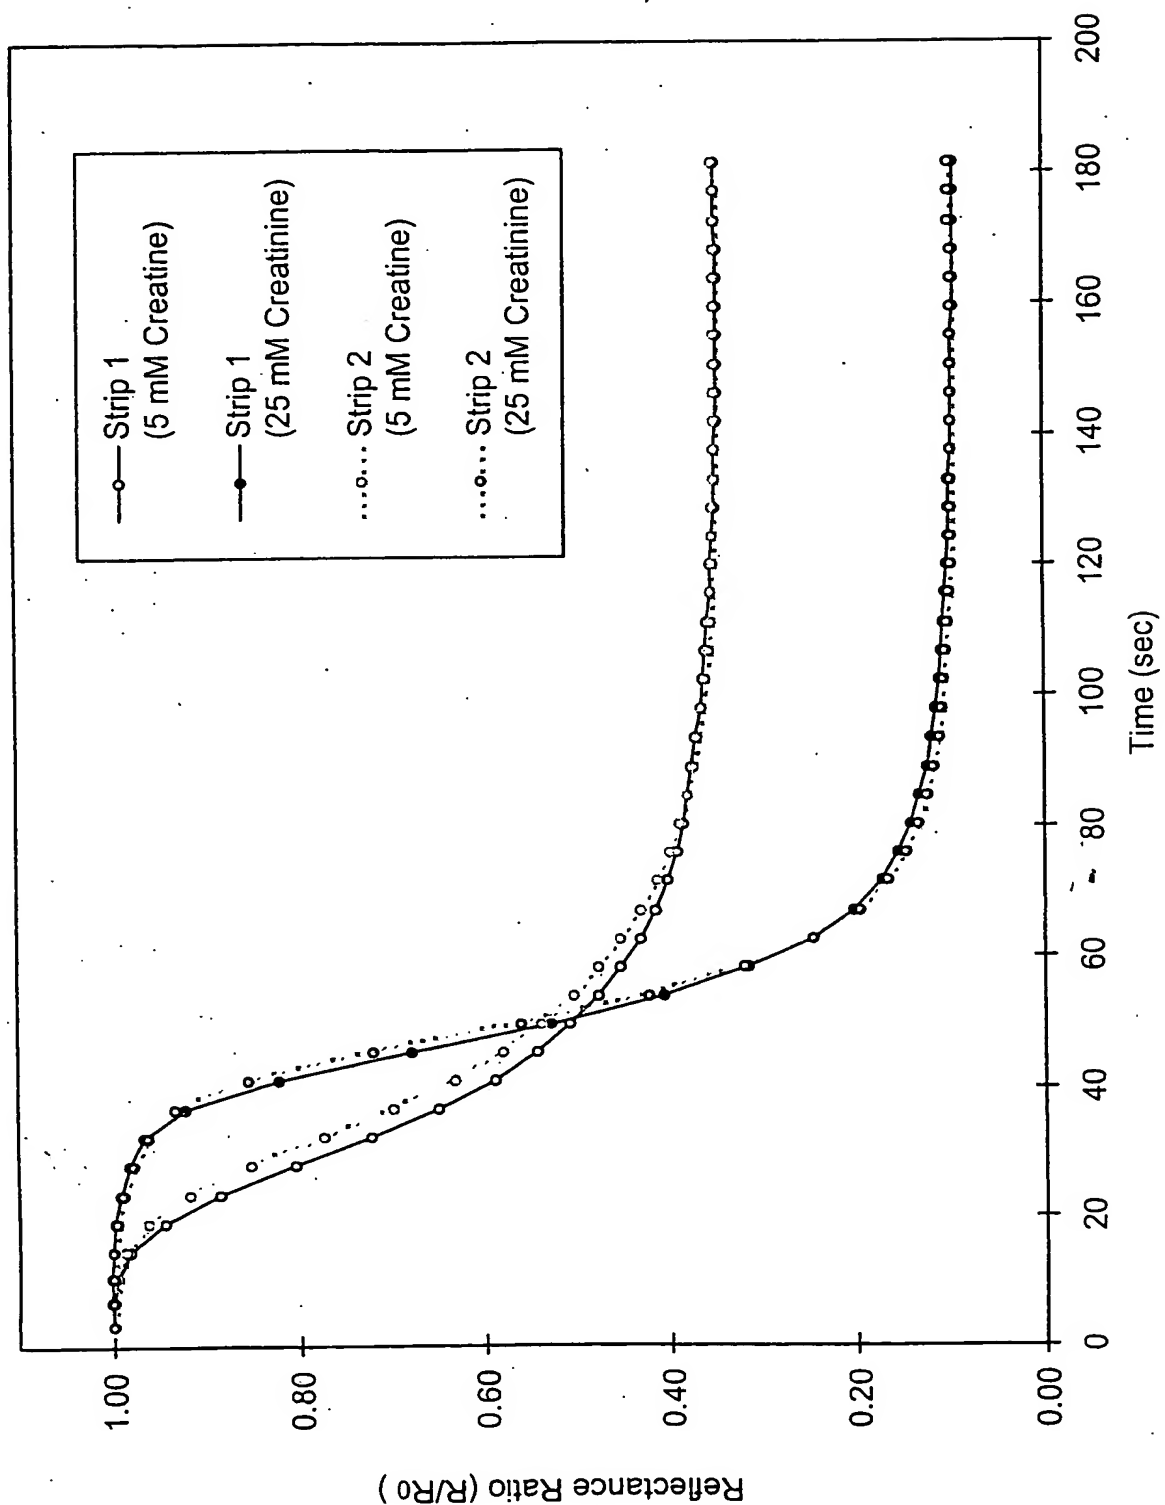


Fig. 4



APPLN. FILING DATE: HERewith
TITLE: DRY REAGENT STRIP CONFIGURATION,
COMPOSITION AND METHOD OF MULTIPLE ANALYTE
DETERMINATION

INVENTOR(S): JOEL M. BLATT ET AL.
ATTORNEY'S DOCKET NO: 033819-016

SHEET 5 of 14


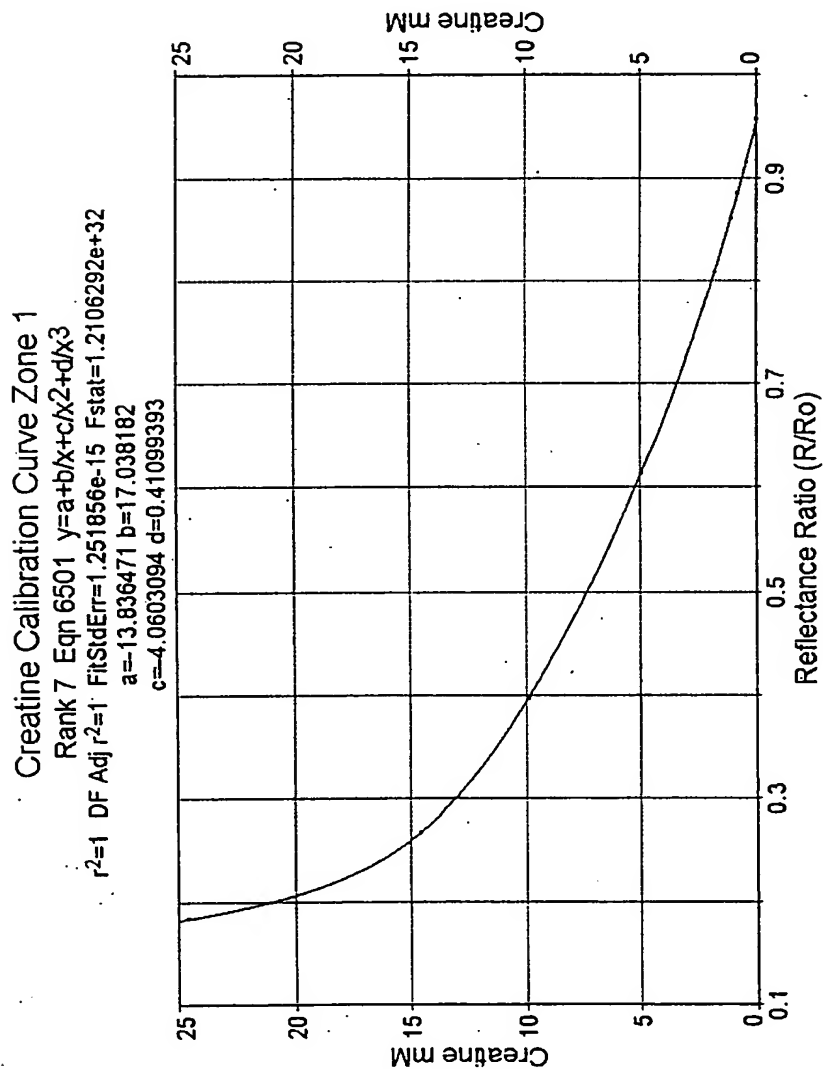


Fig. 5



APPLN. FILING DATE: HERewith
TITLE: DRY REAGENT STRIP CONFIGURATION,
COMPOSITION AND METHOD OF MULTIPLE ANALYTE
DETERMINATION

INVENTOR(S): JOEL M. BLATT ET AL.
ATTORNEY'S DOCKET NO: 033819-016

SHEET 6 of 14

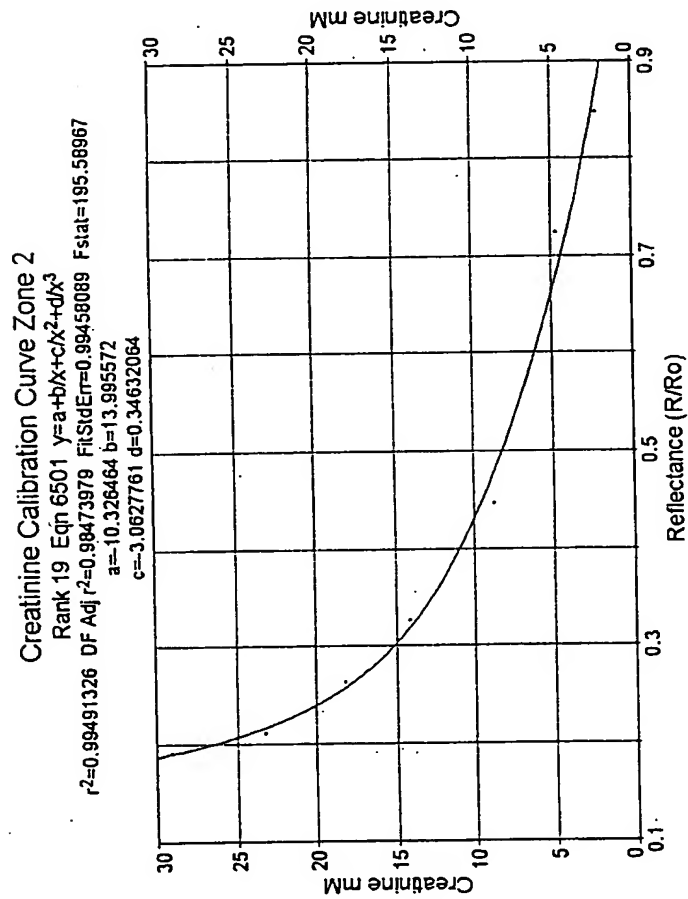


Fig. 6



Accuracy Graph for L/N 98-01-0033


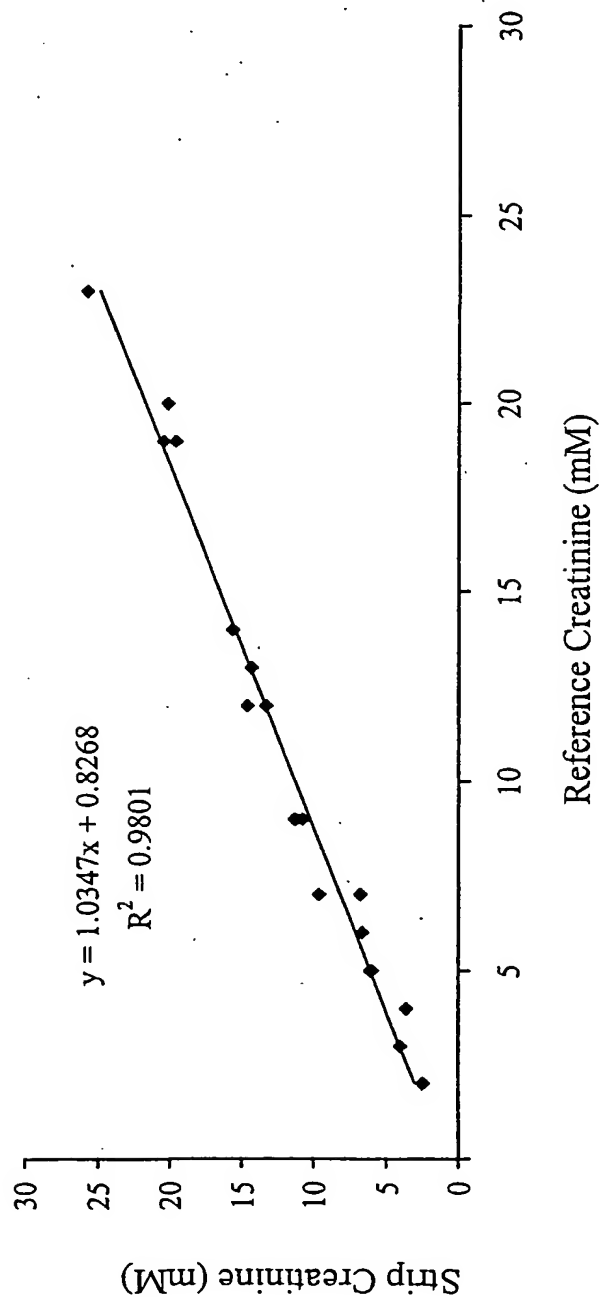


Fig. 7



APPLN. FILING DATE: HERewith
TITLE: DRY REAGENT STRIP CONFIGURATION,
COMPOSITION AND METHOD OF MULTIPLE ANALYTE
DETERMINATION

INVENTOR(S): JOEL M. BLATT ET AL.
ATTORNEY'S DOCKET NO: 033819-016

SHEET 8 of 14

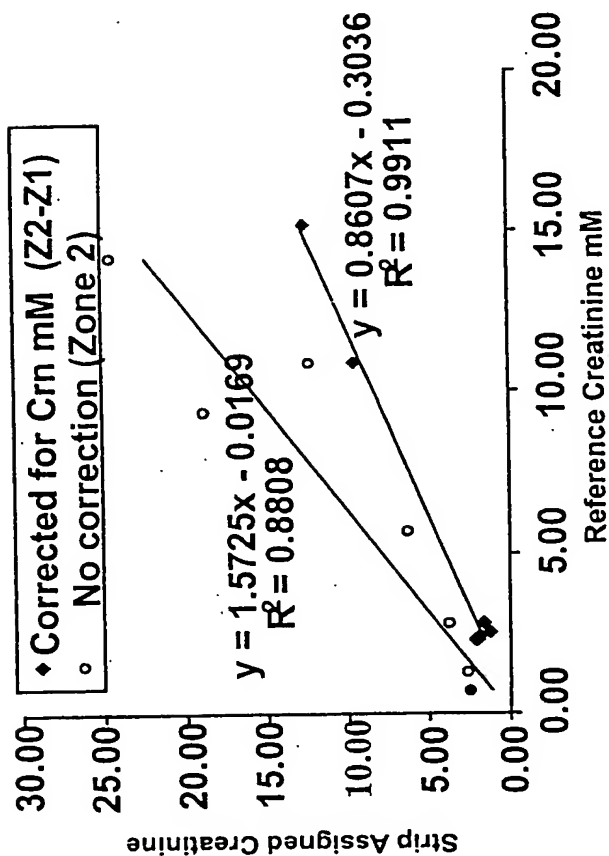


Fig. 8

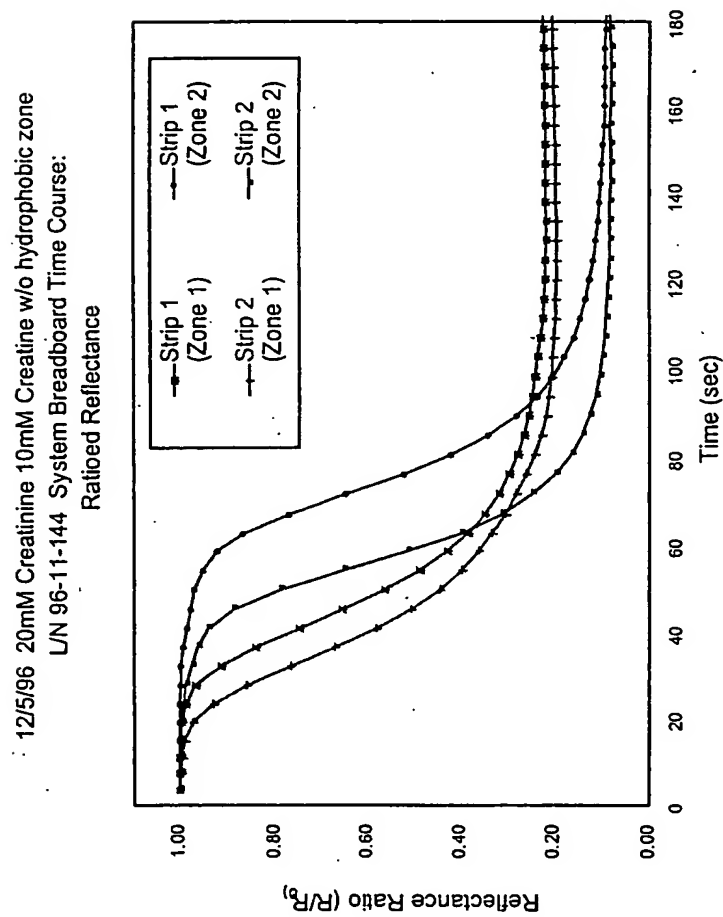


Fig. 9



APPLN. FILING DATE: HEREWITH
TITLE: DRY REAGENT STRIP CONFIGURATION,
COMPOSITION AND METHOD OF MULTIPLE ANALYTE
DETERMINATION

INVENTOR(S): JOEL M. BLATT ET AL.
ATTORNEY'S DOCKET NO: 033819-016

SHEET 10 of 14

12/5/96 20mM Creatinine 10mM Creatine w/hydrophobic zone
L/N 96-11-144 System Breadboard Time Course:
Ratioed Reflectance

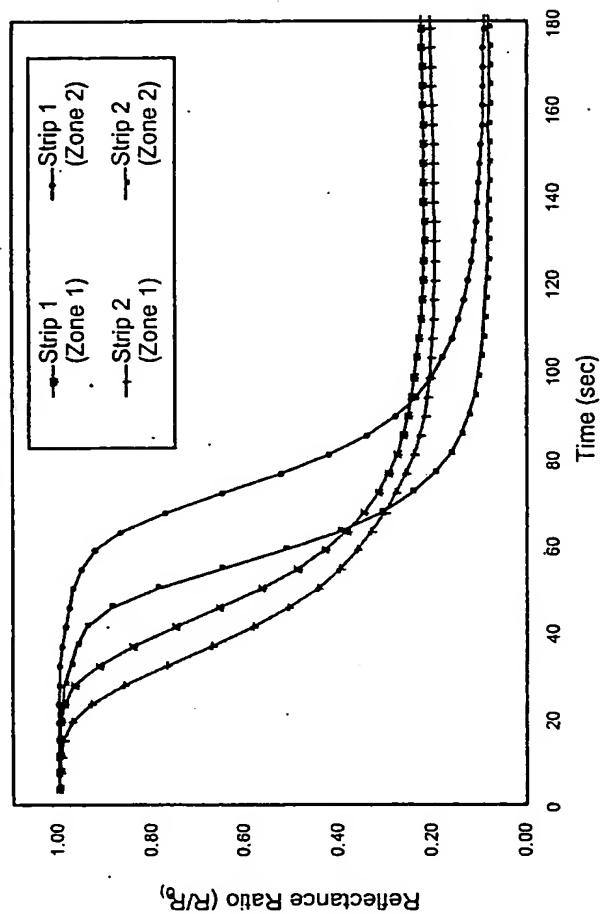


Fig. 10

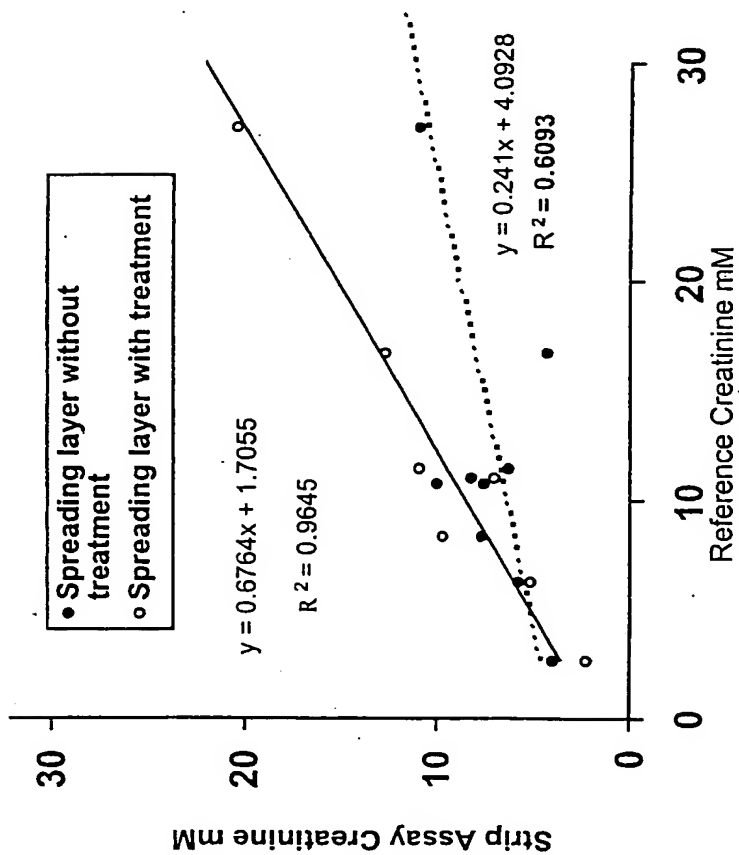


Fig. 11

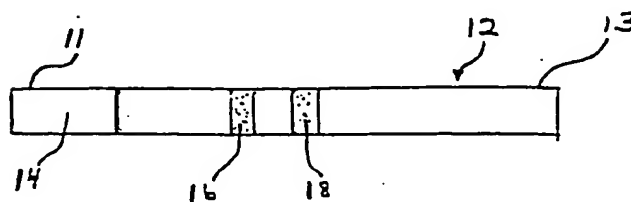


Fig. 12

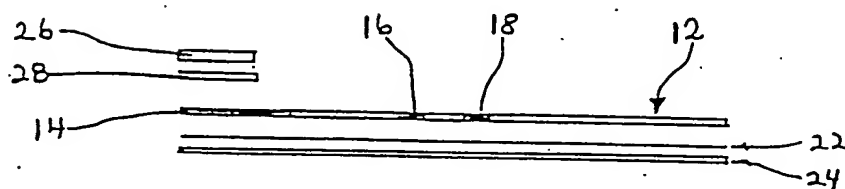


Fig. 13

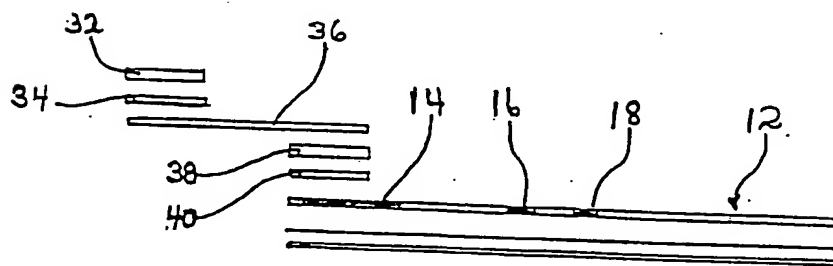


Fig. 14



APPLN. FILING DATE: HERewith
TITLE: DRY REAGENT STRIP CONFIGURATION,
COMPOSITION AND METHOD OF MULTIPLE ANALYTE
DETERMINATION

INVENTOR(S): JOEL M. BLATT ET AL.
ATTORNEY'S DOCKET NO: 033819-016

SHEET 13 of 14

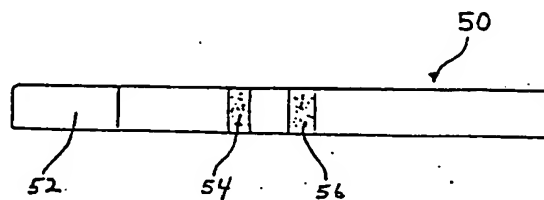


Fig. 15

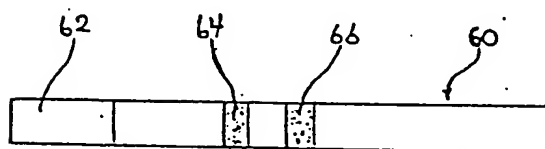


Fig. 16



APPLN. FILING DATE: HERewith
TITLE: DRY REAGENT STRIP CONFIGURATION,
COMPOSITION AND METHOD OF MULTIPLE ANALYTE
DETERMINATION

INVENTOR(S): JOEL M. BLATT ET AL.
ATTORNEY'S DOCKET No: 033819-016

SHEET 14 of 14




Fig. 17